SEC. 32, T.24 N, R4 E, W.M.

GENERAL NOTES

1. FOR PLANTING PLANS SEE SHEET LS12 THROUGH LS14.

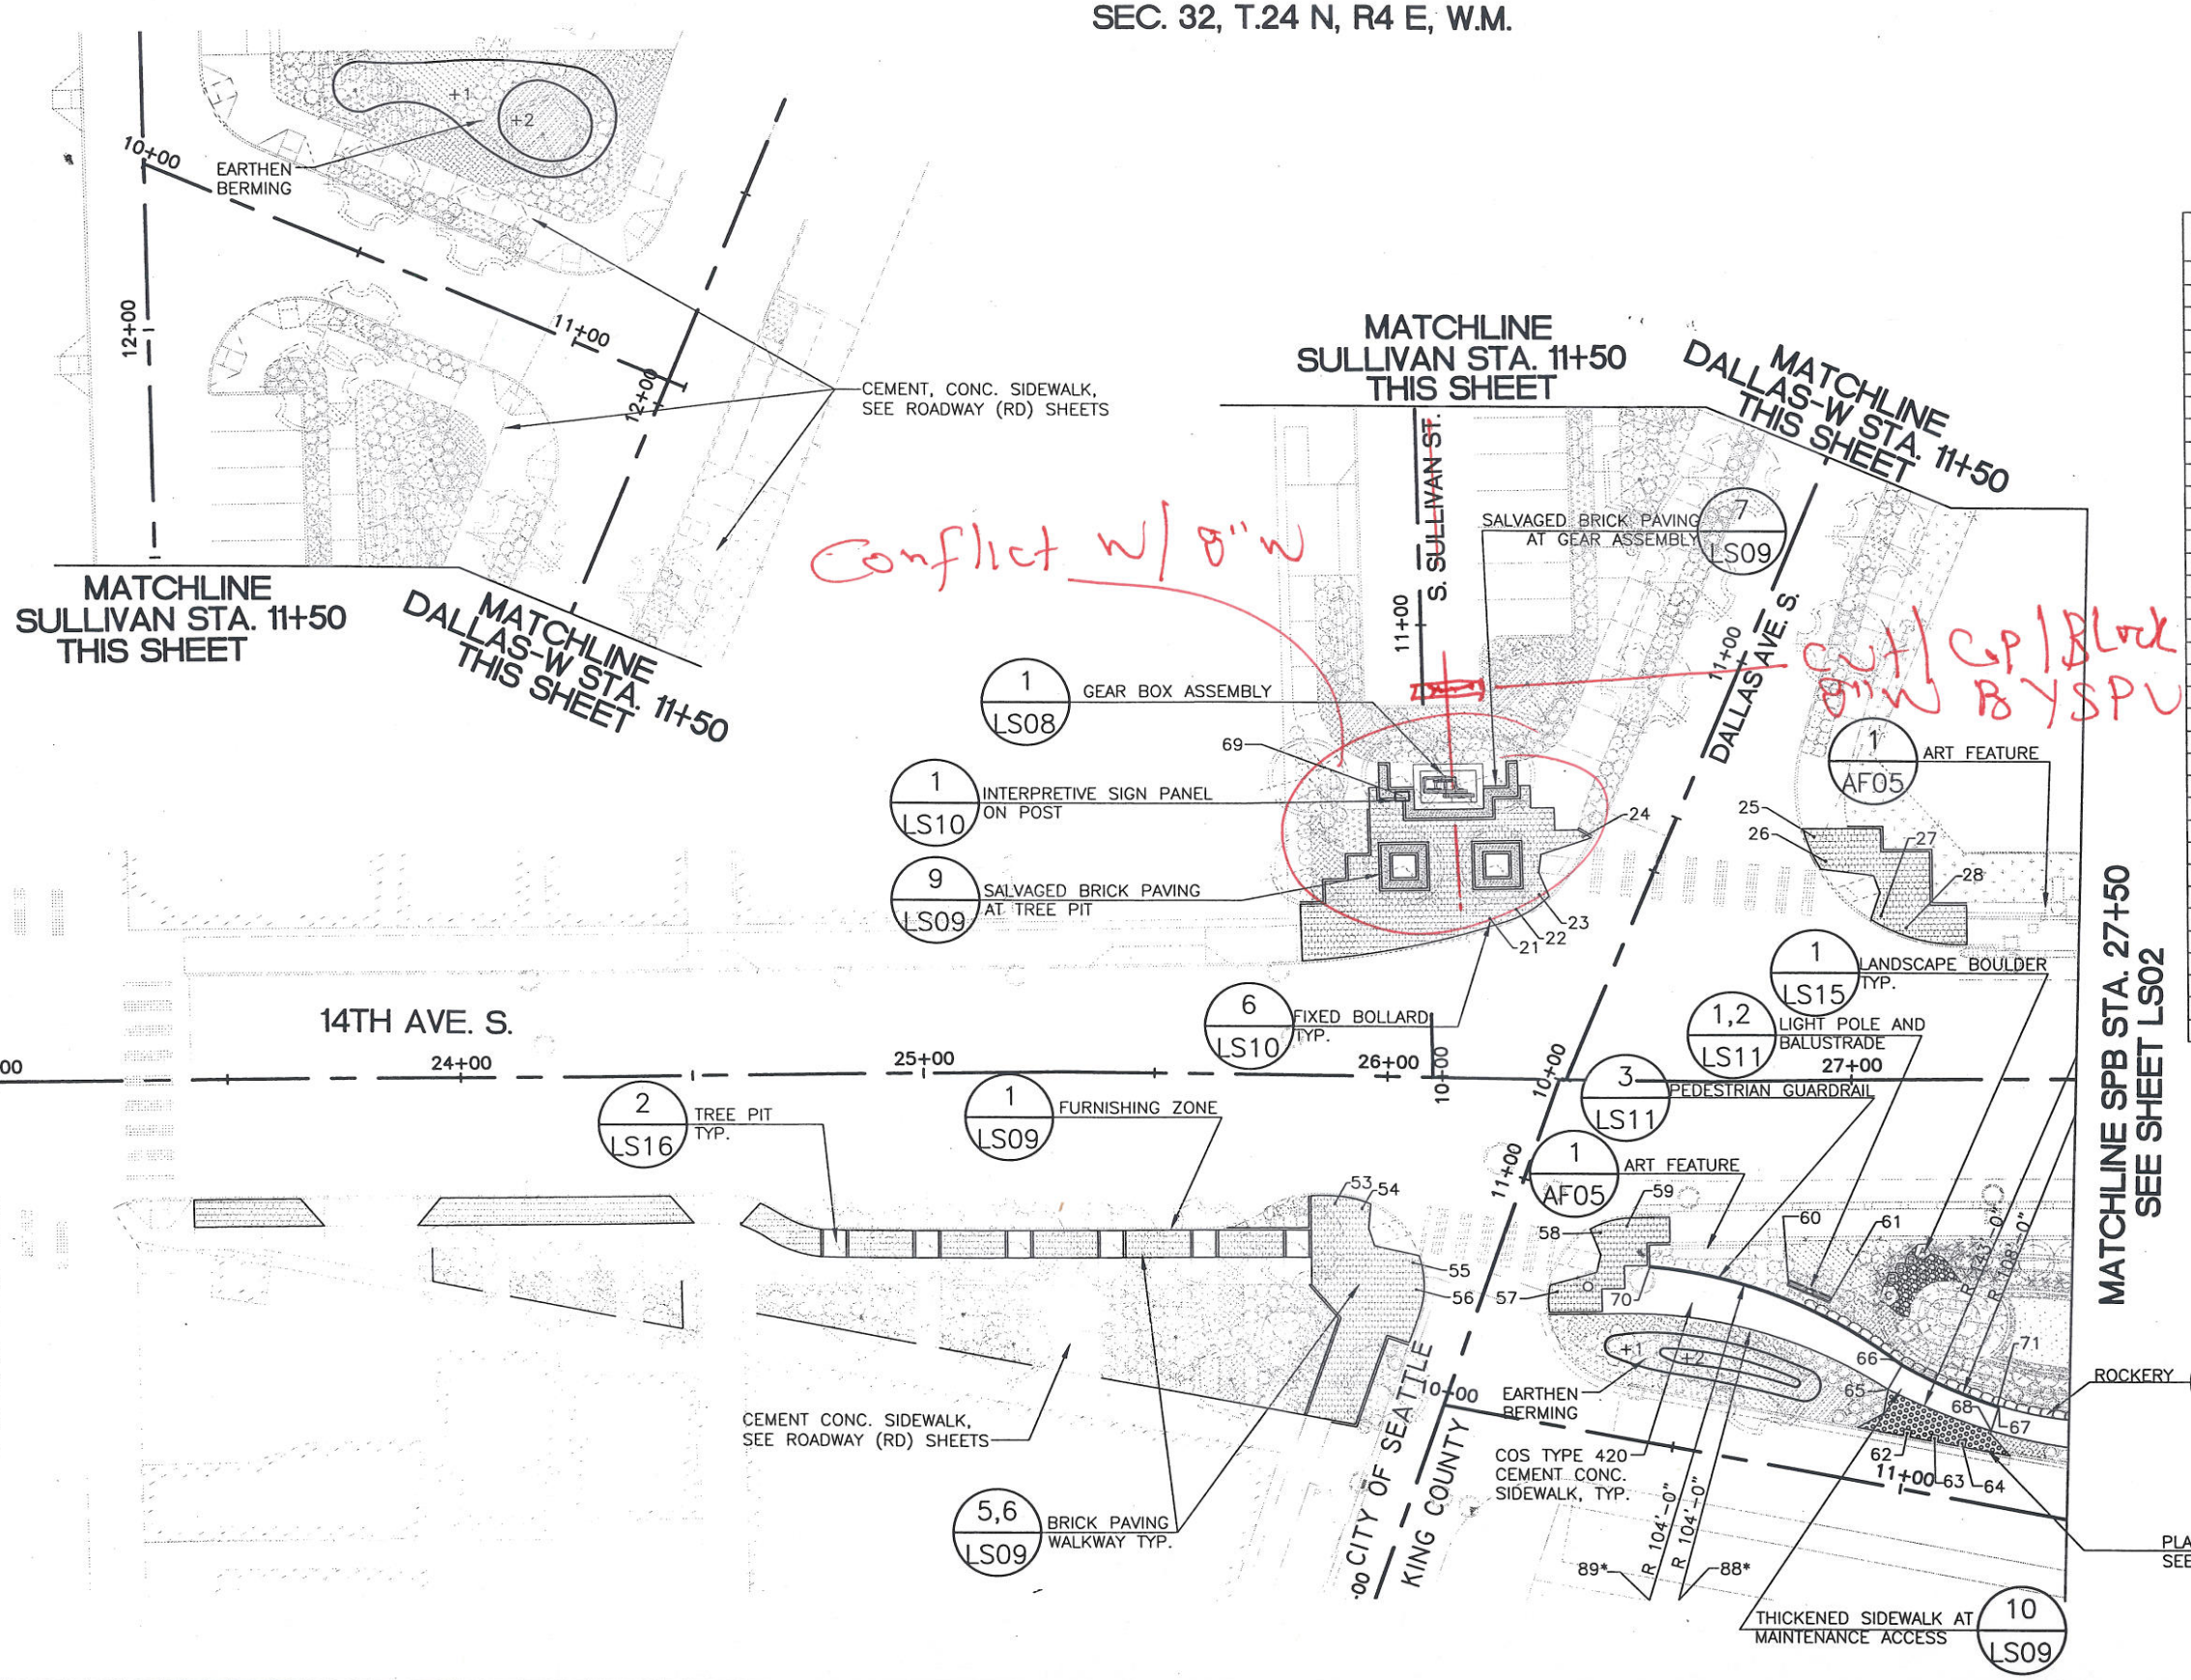

URBAN DESIGN ELEMENTS - LOCATION TABLE

POINT	DESCRIPTION	ELEVATION	NORTHING	EASTING
1–20	NOT USED	–	–	–
21	FIXED BOLLARD	–	195877.54	1274374.72
22	FIXED BOLLARD	–	195883.22	1274372.90
23	FIXED BOLLARD	–	195888.30	1274369.84
24	FIXED BOLLARD	–	195898.36	1274357.38
25	FIXED BOLLARD	–	195948.26	1274359.68
26	FIXED BOLLARD	–	195950.50	1274365.21
27	FIXED BOLLARD	–	195961.84	1274377.79
28	FIXED BOLLARD	–	195967.11	1274380.56
29–52	NOT USED	–	–	–
53	FIXED BOLLARD	–	195841.15	1274436.38
54	FIXED BOLLARD	–	195846.89	1274437.78
55	FIXED BOLLARD	–	195857.16	1274450.03
56	FIXED BOLLARD	–	195857.54	1274455.94
57	FIXED BOLLARD	–	195887.77	1274457.63
58	FIXED BOLLARD	–	195897.76	1274445.04
59	FIXED BOLLARD	–	195903.53	1274443.77
60	LIGHT/BALLUSTRADE	–	195937.76	1274457.79
61	LIGHT/BALLUSTRADE	–	195946.81	1274462.04
62	REMOVABLE BOLLARD	17.18'	195961.80	1274491.87
63	REMOVABLE BOLLARD	17.07'	195967.65	1274493.22
64	REMOVABLE BOLLARD	16.95'	195973.49	1274494.57
65	THICKENED SIDEWALK	16.66'	195958.15	1274482.10
66	THICKENED SIDEWALK	16.52'	195961.54	1274476.70
67	THICKENED SIDEWALK	16.23'	195981.94	1274486.65
68	THICKENED SIDEWALK	16.35'	195979.98	1274492.04
69	INTERPRETIVE SIGN	–	195860.06	1274346.93
70	BEGIN PED. RAILING	–	195908.01	1274453.08
71	END PED. RAILING	–	195981.45	1274486.87
72–85	NOT USED	–	–	–
86	RADIUS POINT	–	196018.83	1274385.15
87	RADIUS POINT	–	196028.14	1274357.40
88	RADIUS POINT*	–	195897.95	1274566.87
89	RADIUS POINT*	–	195893.95	1274555.76

* RADIUS POINT IS OUTSIDE OF PROJECT BOUNDARY

LEGEND:

- SALVAGED BRICK PAVING
- NEW BRICK PAVING
- GRASS PAVING
- STREAMBED COBBLES

20 10 0 20 40
SCALE IN FEET

FIELD BOOK:							
SURVEYED:							
SURVEY BASE MAP:							
DESIGN ENTERED:	J. LOGAN	06/2009					
DESIGNED	J. LOGAN	06/2009					
CHECKED:	B. ELROD	12/2009					
SUPERVISOR:	B. ELROD	01/2010	NUM.	REVISION	BY	DATE	

STATE OF WASHINGTON REGISTERED LANDSCAPE ARCHITECT
BRIAN ELROD CERTIFICATE NO. 663

HNTB

FED. AID No.
PROJECT No. 300197
SURVEY No. 32-24-4-22
MAINTENANCE DIVISION No. 3

KING COUNTY DEPT. OF TRANSPORTATION
HAROLD TANIGUCHI, DIRECTOR

SOUTH PARK BRIDGE #3179 REPLACEMENT

ARCHITECTURAL LAYOUT PLAN – 1

King County

LS01

SHEET 158 OF 667 SHEETS

316-63 (___)

SEC. 32, T.24 N, R.4 E, W.M.

8" FS BY SPU

S SULLIVAN ST 11+00

SERVICE CONNECTION TO EXIST. 12" WATER MAIN (BY OTHERS – SPU)

8" W AND GATE VALVE (BY OTHERS – SPU)

DECTECTOR CHECK VAULT (SEE NOTE 2)

SOUTH BACKFLOW PREVENTER VAULT (SEE NOTE 2)

DALLAS AVE. S. 11+00

EXIST FIRE HYDRANT AND WATER VALVE

EXISTING VALVE BOXES

45 EL + 22.5 EL STA 26+9.23, LT 65.29

2" PVC FORCE MAIN 45 EL STA 27+06.24, LT 57.30

8" BURIED WET FIRE LINE (SEE NOTE 1)

FIRE HYDRANT STA 27+00.69, 41.24 LT

TERMINATE 2" FORCE MAIN INTO STORM DRAIN CURB INLET

8" BURIED WET FIRE LINE OFFSET 19.69 LT. ℄ ELEV 4.75 FT BELOW FINISHED ROAD ELEV (SEE NOTE 1)

8x8x6 TEE, STA 27+06.24, LT 20.36

6" BURIED WET FIRE LINE, C ELEV 4.75 FT BELOW FINISHED ROAD ELEV (SEE NOTE 1)

90 EL, STA 27+06.24, RT 19.47

14TH AVE. S.

23+00 24+00 25+00 26+00 27+00

10+00

90 EL, STA 26+42.92, RT 19.47

FIRE HYDRANT STA 26+49.50, 53.19 RT

DALLAS AVE. S. 10+00

11+00

MATCHLINE SPB STA. 27+50
SEE SHEET FP02

BY KC

NOTES:

1. ALL BURIED DI PIPE JOINTS SHALL BE RESTRAINED TYP.
2. SEE FP09 FOR DETECTOR CHECK AND BACKFLOW PREVENTER INSTALLATION DETAILS.

LEGEND:

- THRUST BLOCK
- GATE VALVE
- FIRE HYDRANT

20 10 0 20 40
SCALE IN FEET

CALL 2 WORKING DAYS BEFORE YOU DIG
1-800-424-5555
(UNDERGROUND UTILITY LOCATIONS ARE APPROX.)

A. NAPIER	06/2009				
D. PARKER	06/2009				
J. CASEY	10/2009				
J. CASEY	01/2010	NUM.	REVISION	BY	DATE

DAVID B. PARKER — STATE OF WASHINGTON — 26243 — REGISTERED PROFESSIONAL ENGINEER

HNTB

FED. AID No.

PROJECT No. 300197

SURVEY No. 32-24-4-22

MAINTENANCE DIVISION No. 3

KING COUNTY DEPT. OF TRANSPORTATION
HAROLD TANIGUCHI, DIRECTOR

SOUTH PARK BRIDGE #3179 REPLACEMENT

FIRE PROTECTION PLANS – 1

King County

FP01

SHEET 583 OF 667 SHEETS

316-63 ( )

SEC. 28,29,32,33 T.24 N, R.4 E, W.M.

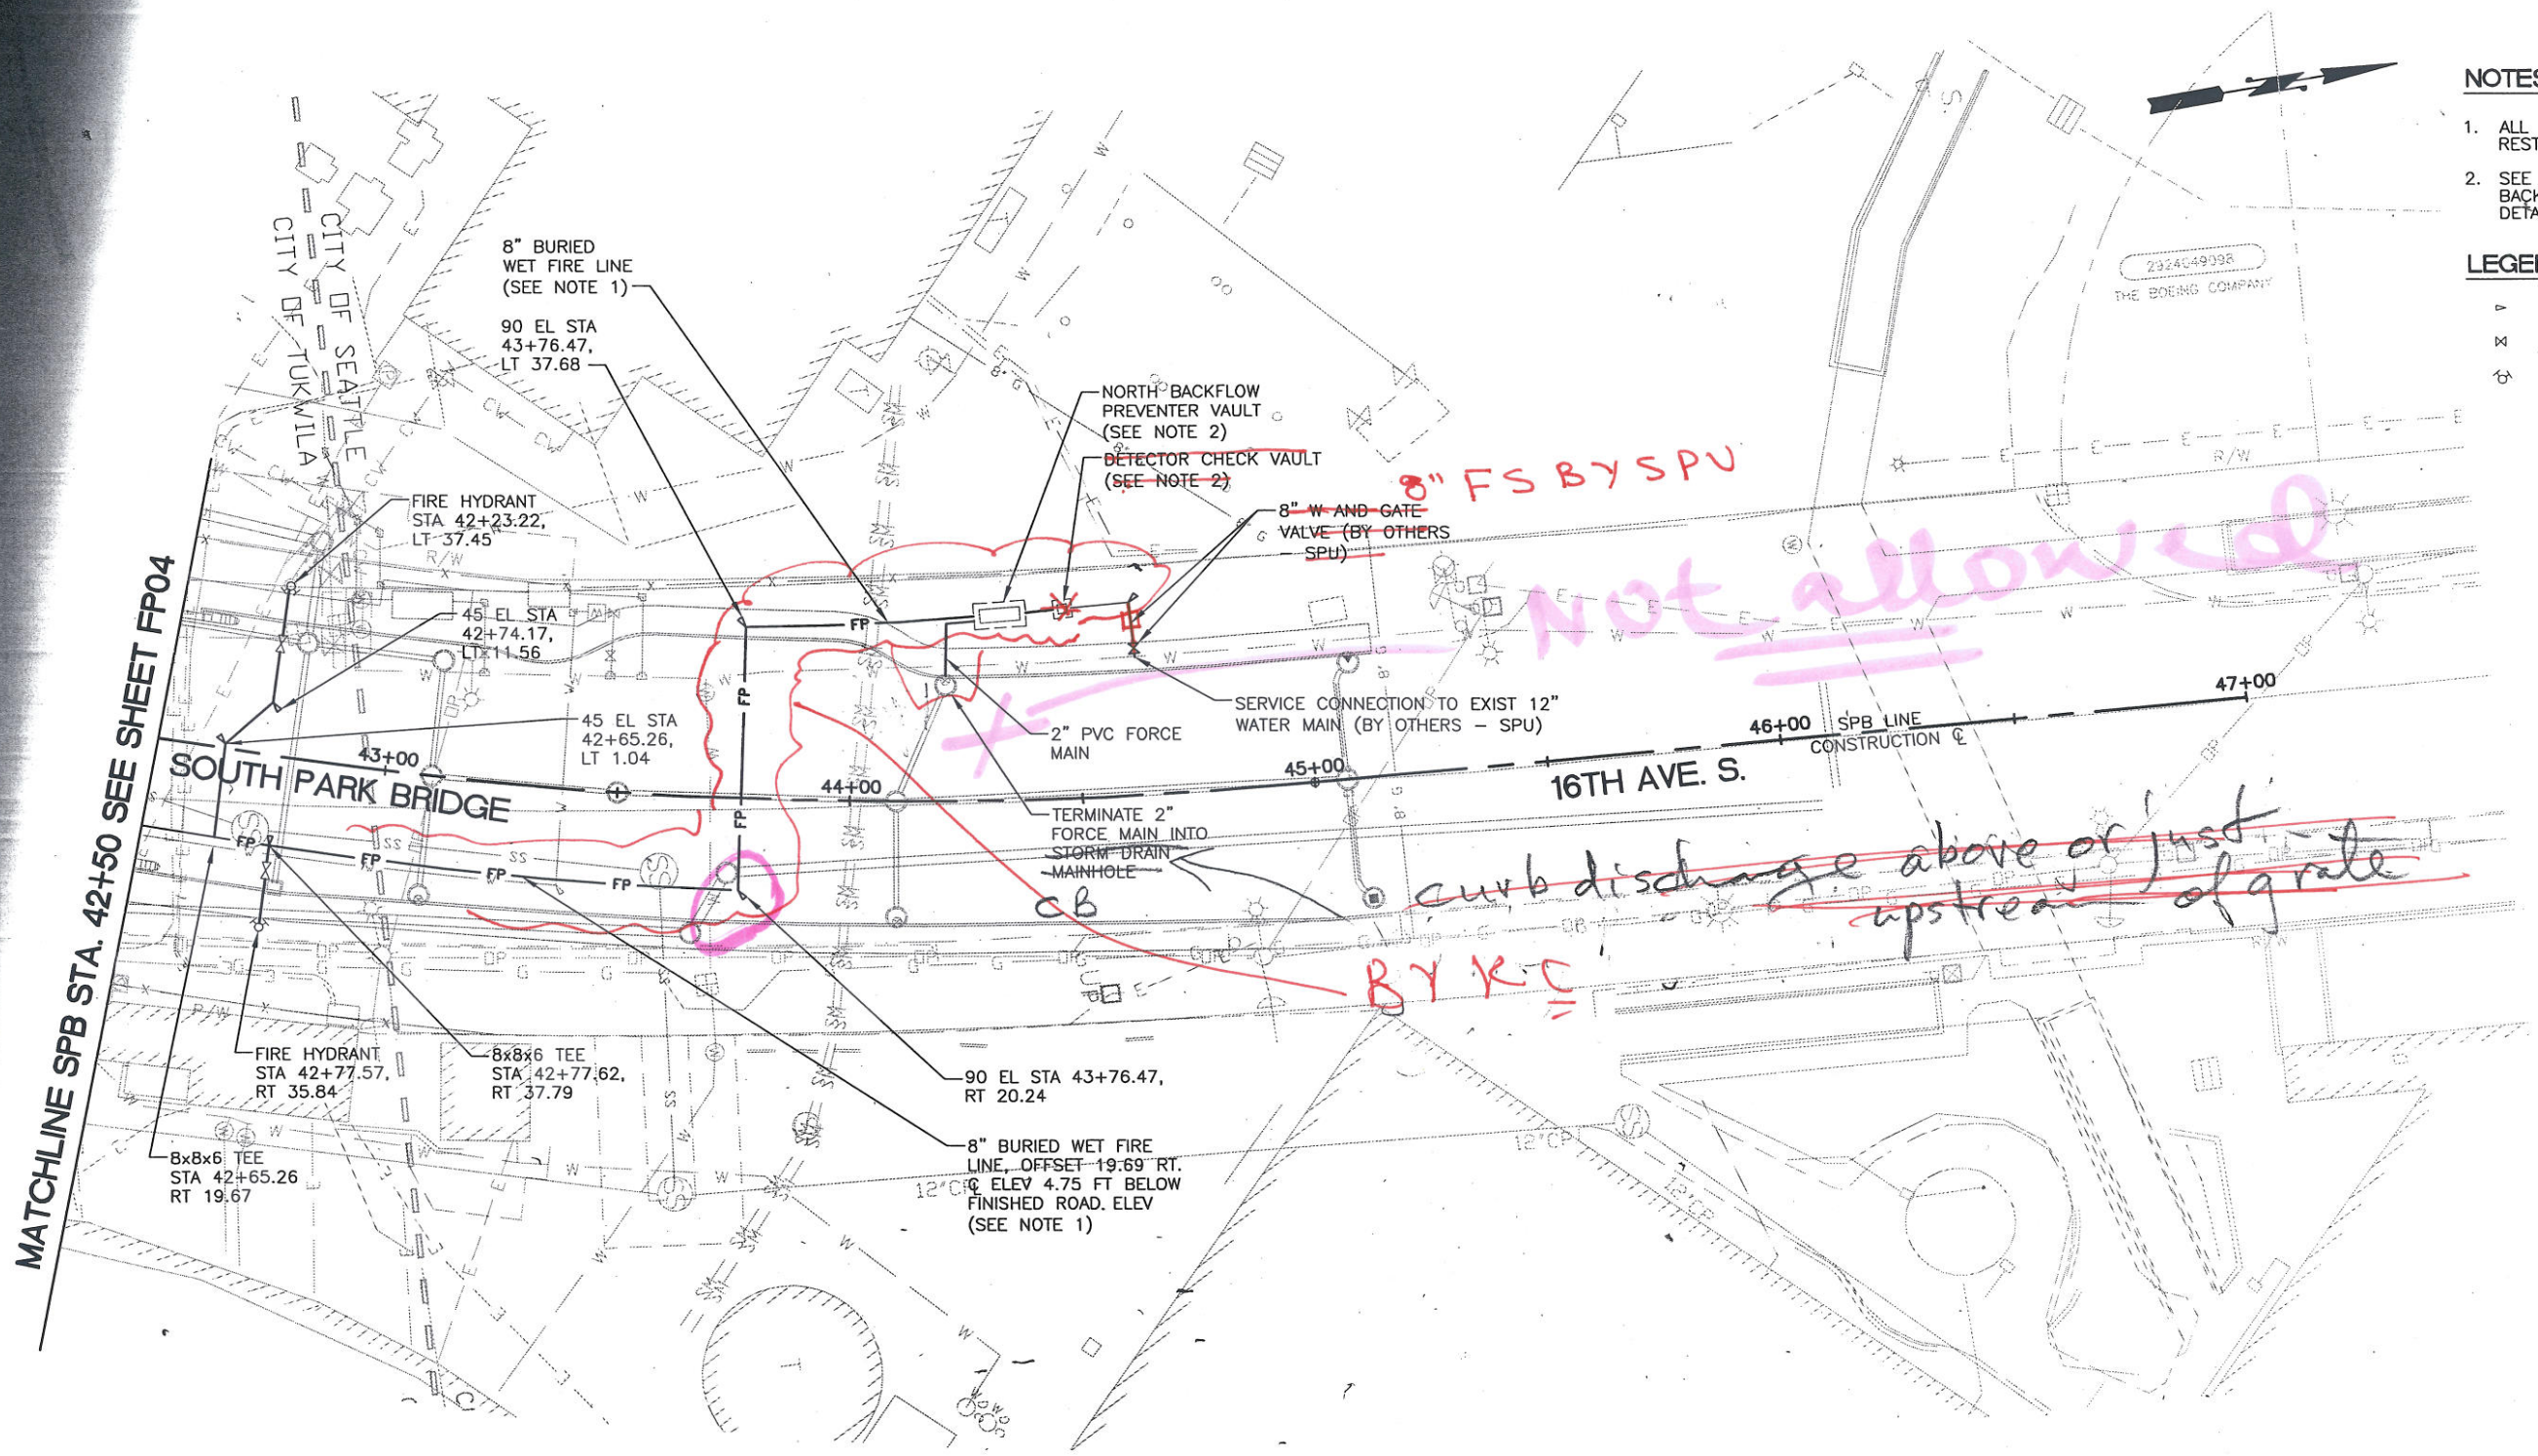

NOTES:

1. ALL BURIED DI PIPE JOINTS SHALL BE RESTRAINED TYP.
2. SEE FP09 FOR DETECTOR CHECK AND BACKFLOW PREVENTER INSTALLATION DETAILS.

LEGEND:

- ⊳ THRUST BLOCK
- ⋈ GATE VALVE
- FIRE HYDRANT

20 10 0 20 40
SCALE IN FEET

CALL 2 WORKING DAYS BEFORE YOU DIG
1-800-424-5555
(UNDERGROUND UTILITY LOCATIONS ARE APPROX.)

FIELD BOOK:			
SURVEYED:			
SURVEY BASE MAP:			
DESIGN ENTERED:	A. NAPIER	06/2009	
DESIGNED	D. PARKER	06/2009	
CHECKED:	J. CASEY	10/2009	
SUPERVISOR:	J. CASEU	01/2010	

NUM.	REVISION	BY	DATE

DAVID B. PARKER — STATE OF WASHINGTON — 28243 — REGISTERED PROFESSIONAL ENGINEER

HNTB

FED. AID No.

PROJECT No. 300197

SURVEY No. 32-24-4-22

MAINTENANCE DIVISION No. 3

KING COUNTY DEPT. OF TRANSPORTATION
HAROLD TANIGUCHI, DIRECTOR

SOUTH PARK BRIDGE #3179 REPLACEMENT

FIRE PROTECTION PLANS - 5

King County

FP05

SHEET 587 OF 667 SHEETS

316-63 (___)